



6"


**DAMAGE CONTROL SIGNAGE SKETCH # 080** DANGER, CARBON DIOXIDE GAS, WHEN ALARM SOUNDS OR LIGHT IS RED KEEP OUT OF SPACE (9" x 6")


5-85


NOTE: RETROREFLECTIVE MATERIAL (WHITE, BLACK AND RED) **BLACK RETROREFLECTIVE LETTERS** GRAPHIC IS NOT TO SCALE.



9"

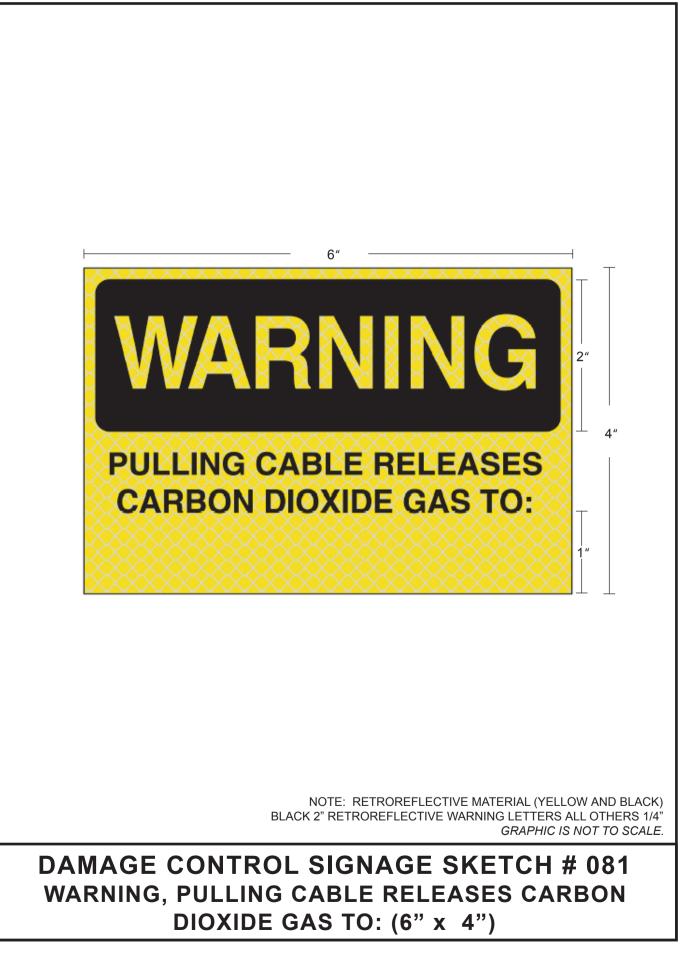

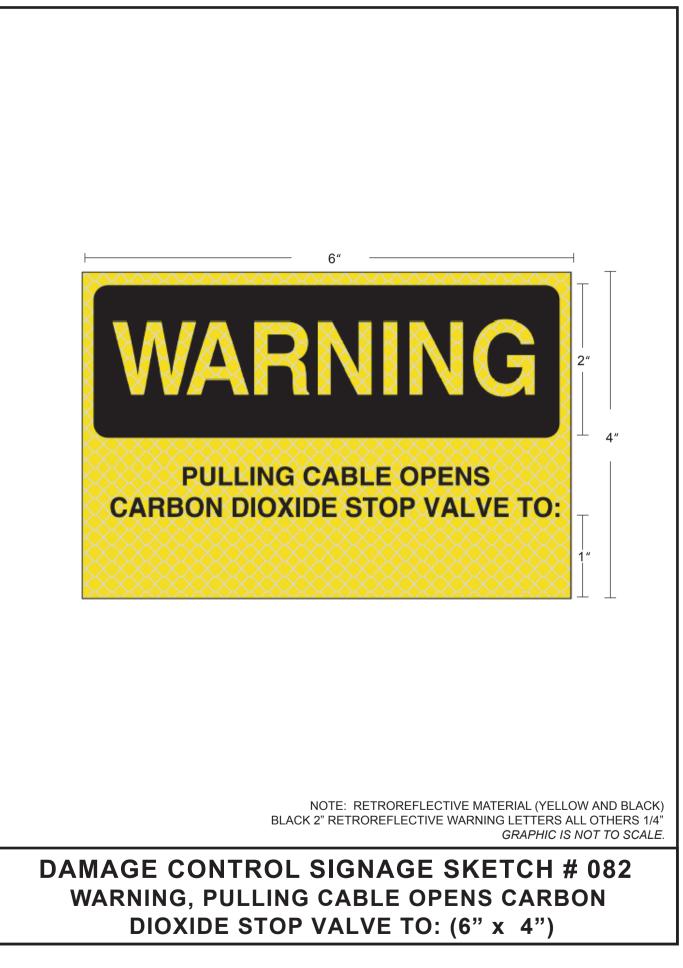

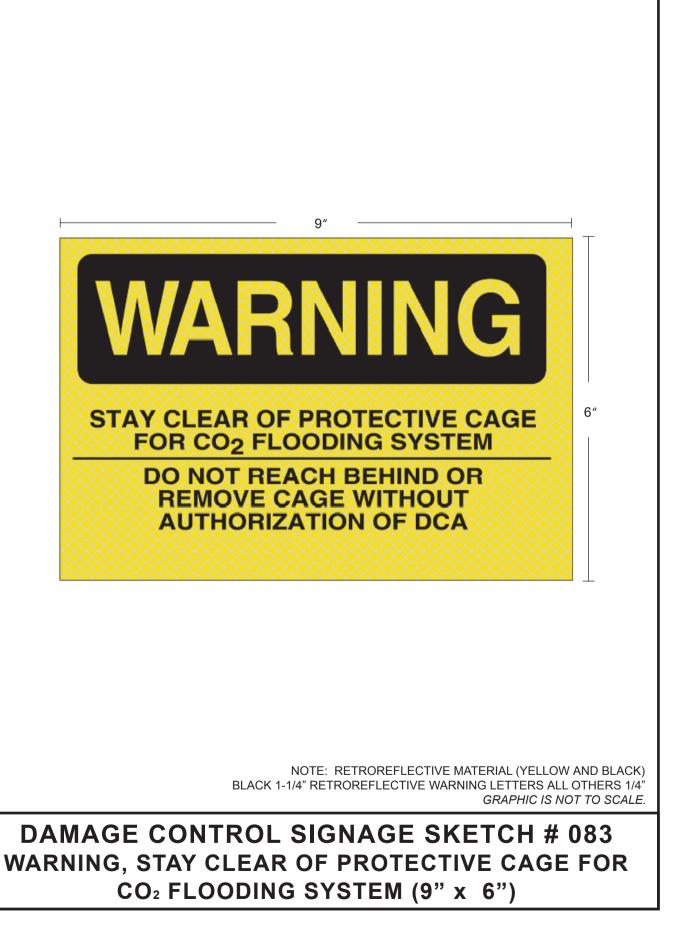

HALON 1301 MAY PRODUCE TOXIC BY-PRODUCTS WHEN EXPOSED TO FIRE. ALL PERSONNEL MUST LEAVE THE SPACE WHEN HALON SYSTEM IS ACTUATED. AFTER HALON HAS BEEN DISCHARGED TO EXTINGUISH A FIRE THE SPACE MUST NOT BE ENTERED FOR 15 MINUTES. AFTER WAITING THE ABOVE 15 MINUTES, AND THE FIRE HAS BEEN EXTINGUISHED, RESET VENTILATION SHUTDOWN PRESSURE SWITCH IN THE HALON SYSTEM AND OPERATE VENTILATION SUPPLY AND EXHAUST SYSTEM AT HIGH SPEED FOR 15 MINUTES. DO NOT ENTER THE SPACE WITHOUT RESPIRATOR PROTECTION (OBA/SCBA) OR UNTIL THE SPACE HAS BEEN VENTILATED FOR 15 MINUTES AS STATED ABOVE AND CERTIFIED GAS FREE. WHEN THE SPACE IS GAS FREE, RESET ALARM PRESSURE SWITCHES.

10"

NOTE: RETROREFLECTIVE MATERIAL (YELLOW) BLACK 1/4" RETROREFLECTIVE LETTERS GRAPHIC IS NOT TO SCALE.

### DAMAGE CONTROL SIGNAGE SKETCH # 084 HALON 1301 MAY PRODUCE TOXIC BY-PRODUCTS WHEN EXPOSED TO FIRE (10" x 7")

7"


# THIS DOOR IS PART OF A FIRE ZONE BOUNDARY

7"

NOTE: RETROREFLECTIVE MATERIAL (YELLOW) BLACK 1/2" RETROREFLECTIVE LETTERS GRAPHIC IS NOT TO SCALE.

#### DAMAGE CONTROL SIGNAGE SKETCH # 085 THIS DOOR IS PART OF A FIRE ZONE BOUNDARY (7" x 3")

3"

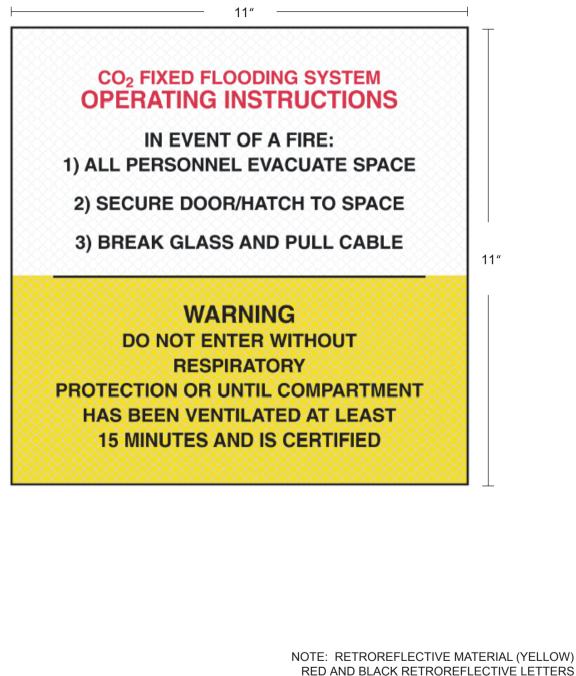

BLACK RETROREFLECTIVE LETTERS GRAPHIC IS NOT TO SCALE.

# DAMAGE CONTROL SIGNAGE SKETCH # 086 CO<sub>2</sub> FIXED FLOODING SYSTEM OPERATING INSTRUCTIONS (11" X 11")

#### CO<sub>2</sub> FIXED FLOODING SYSTEM STOP VALVE OPERATING INSTRUCTIONS

11"

IN EVENT OF A FIRE: 1) ALL PERSONNEL EVACUATE PROTECTED SPACE

2) DO NOT OPERATE STOP VALVE UNTIL SYSTEM HAS BEEN ACTUATED

3) BREAK GLASS AND PULL CABLE

11"

#### WARNING

CO<sub>2</sub> SYSTEM WILL NOT DISCHARGE UNTIL STOP VALVE HAS BEEN ACTUATED. ENSURE ALL PERSONNEL HAVE EVACUATED THE PROTECTED SPACE, SECURED DOORS/HATCHES AND ACTUATED THE ADJACENT CO<sub>2</sub> SYSTEM PULL BOX PRIOR TO OPERATING CO<sub>2</sub> STOP VALVE PULL BOX.

> NOTE: RETROREFLECTIVE MATERIAL (YELLOW) RED AND BLACK RETROREFLECTIVE LETTERS *GRAPHIC IS NOT TO SCALE.*

## DAMAGE CONTROL SIGNAGE SKETCH # 087 CO<sub>2</sub> FIXED FLOODING SYSTEM STOP VALVE OPERATING INSTRUCTIONS (11" X 11")